


TLOCRT

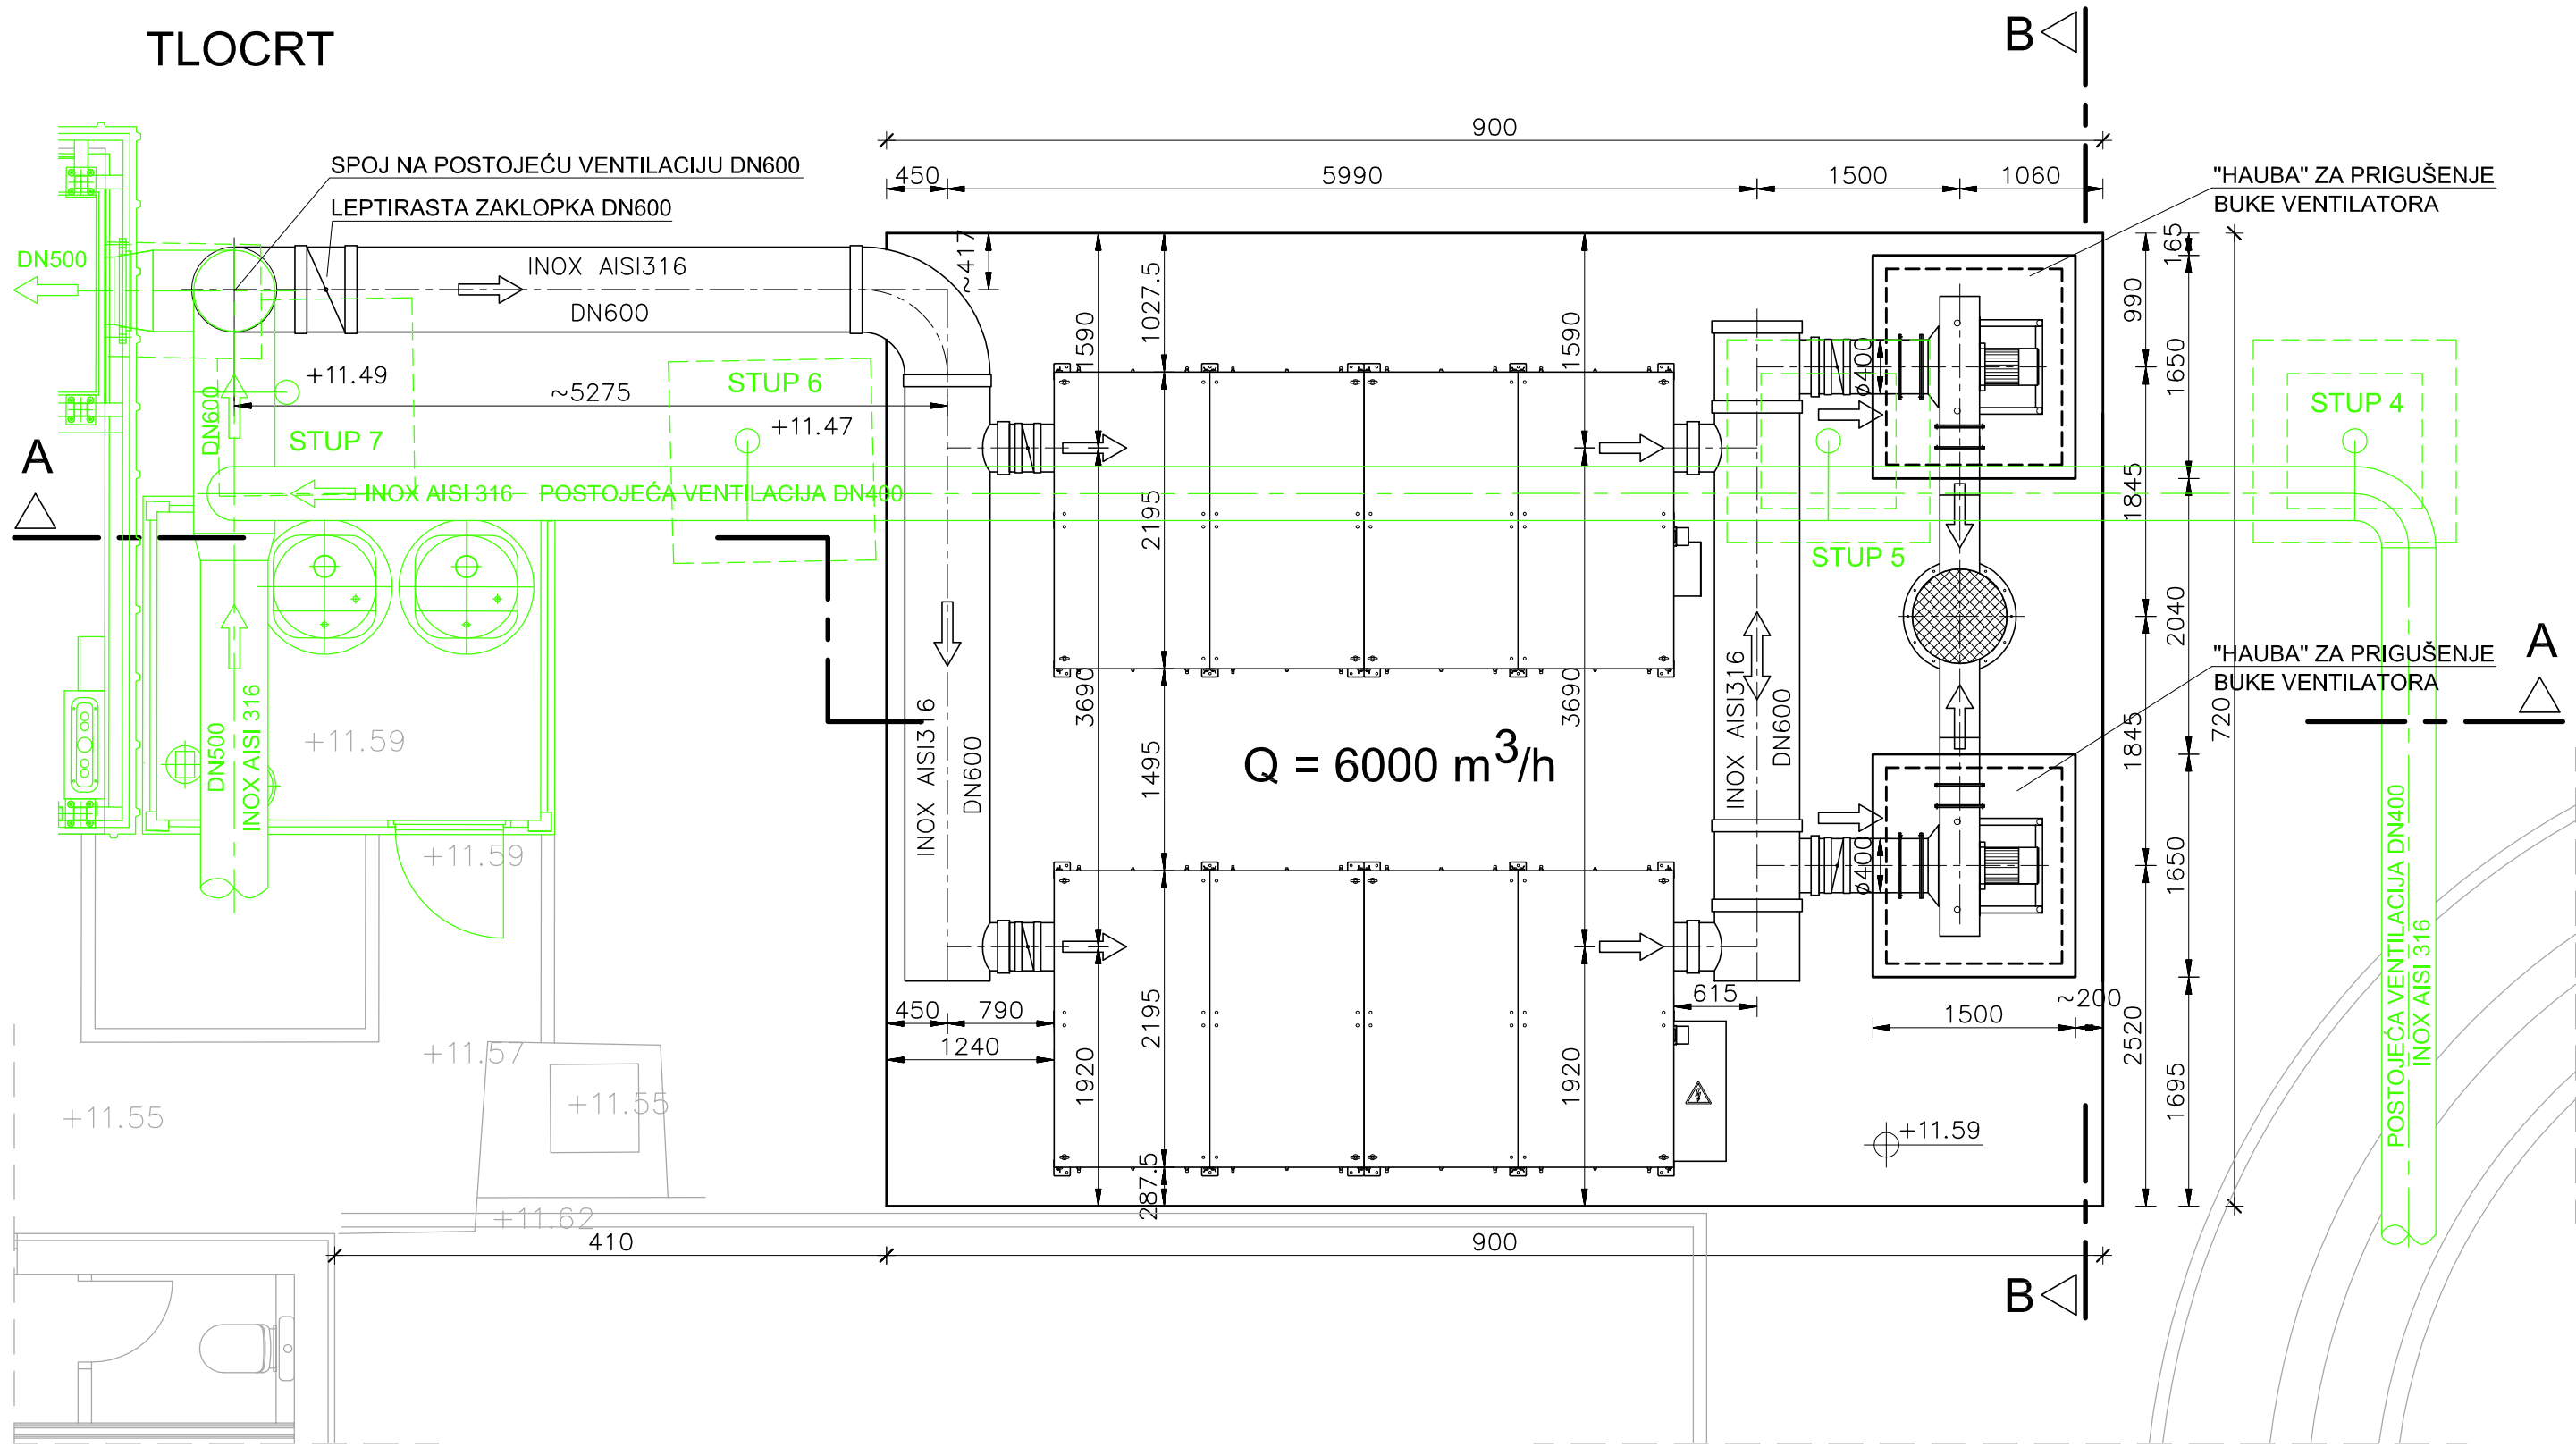


OSNOVNI PODACI O PCO JEDINICI:


- Nazivni kapacitet: 2 x 3000 m<sup>3</sup>/h ( 2+0 )
- Nazivni kapacitet ventilatora: 2 x 6000 m<sup>3</sup>/h ( 1+1 )
- Instalirana snaga:  
UV Lampe: 24 kW  
Ventilatori: 2 x 7,5 kW

DEHIDRACIJA MULJA  
PCO JEDINICA - 6000 m<sup>3</sup>/h  
MJ 1:50

PRESJEK A - A

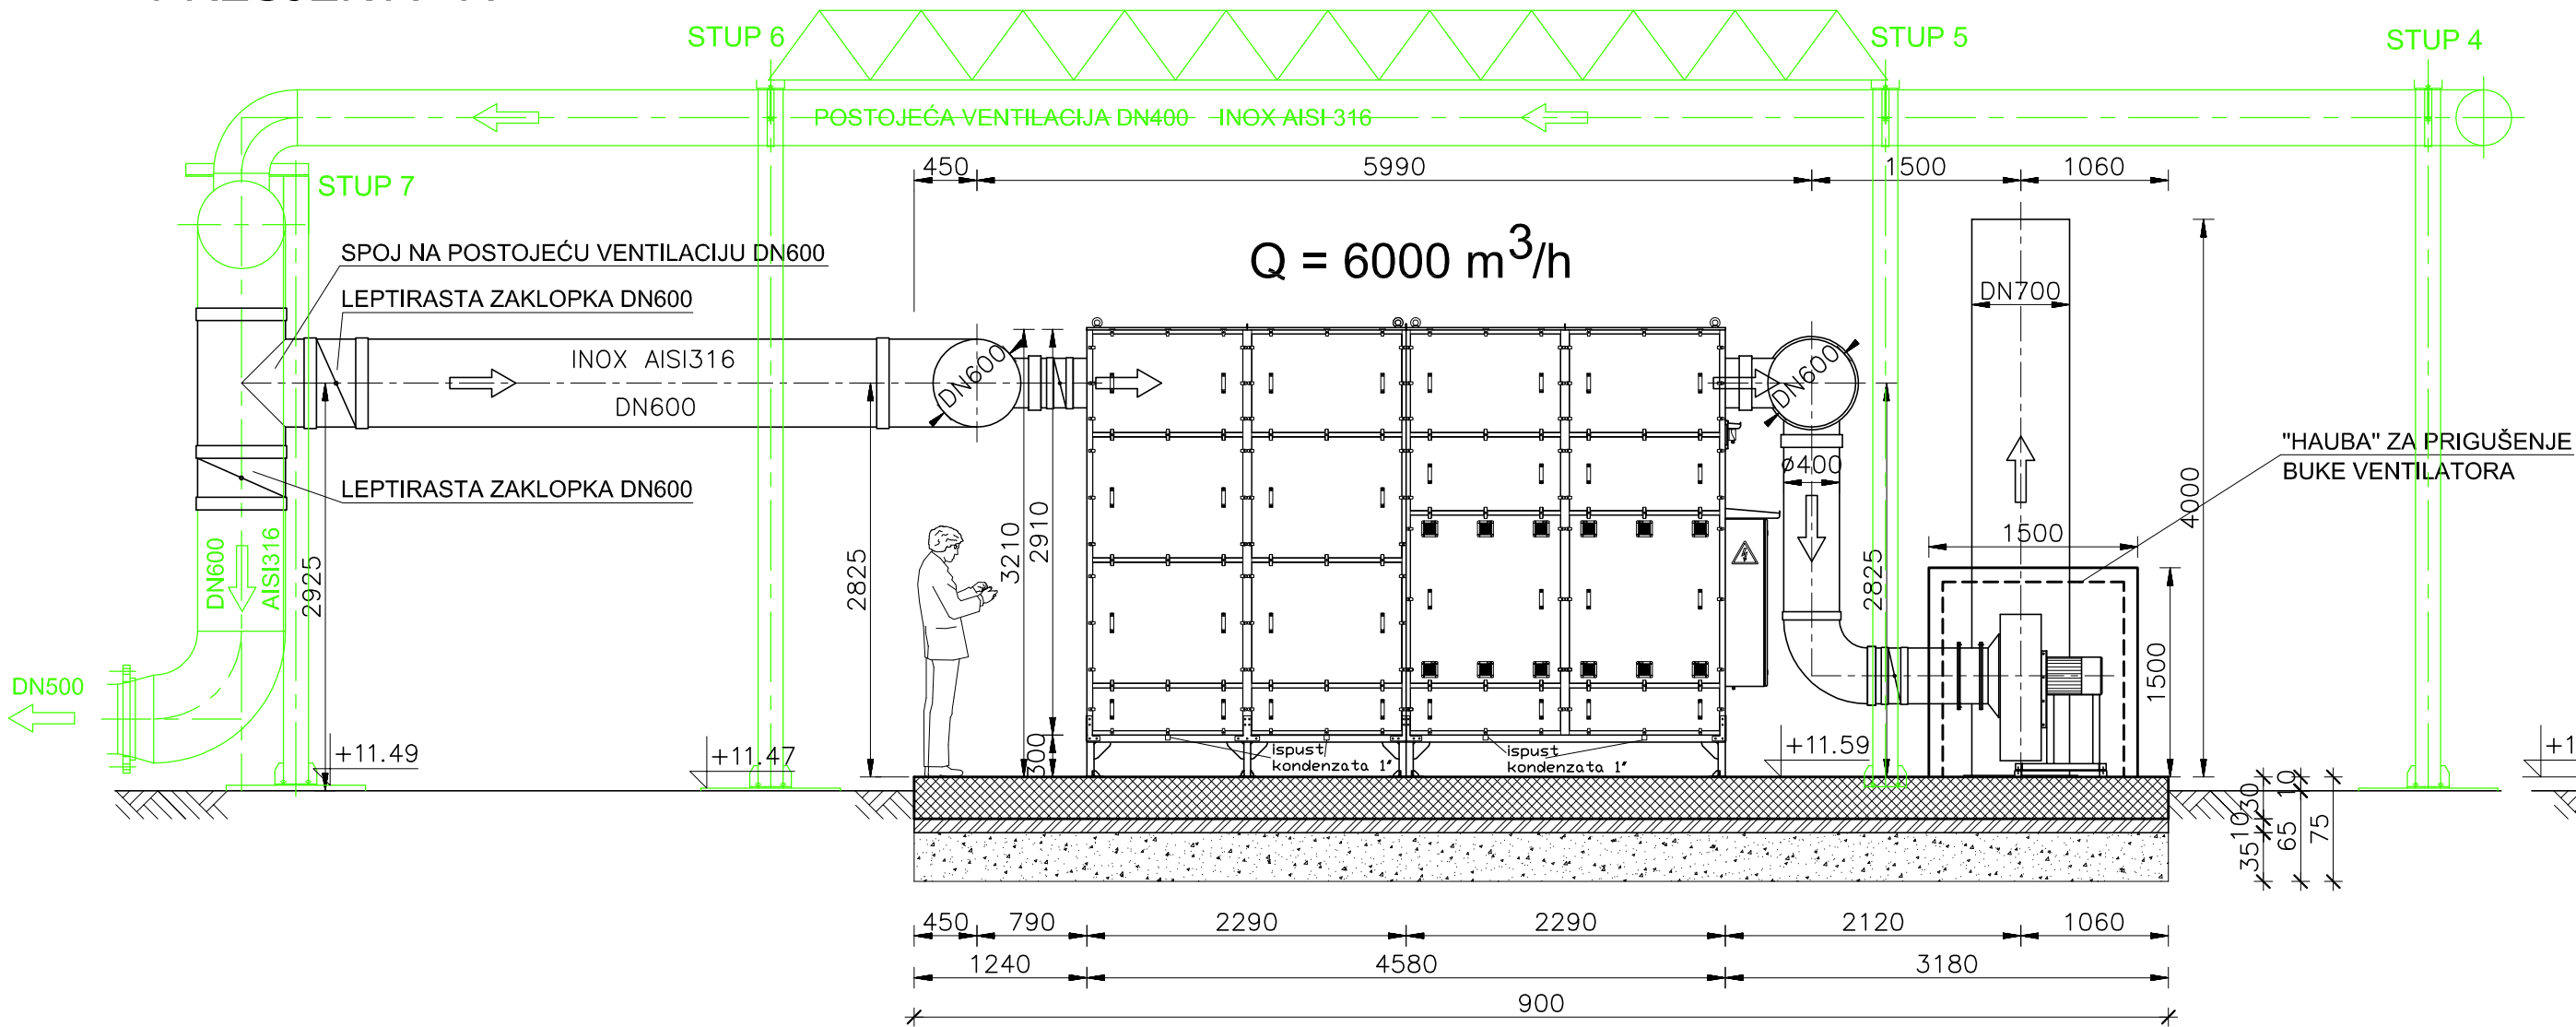

PRESJEK B - B

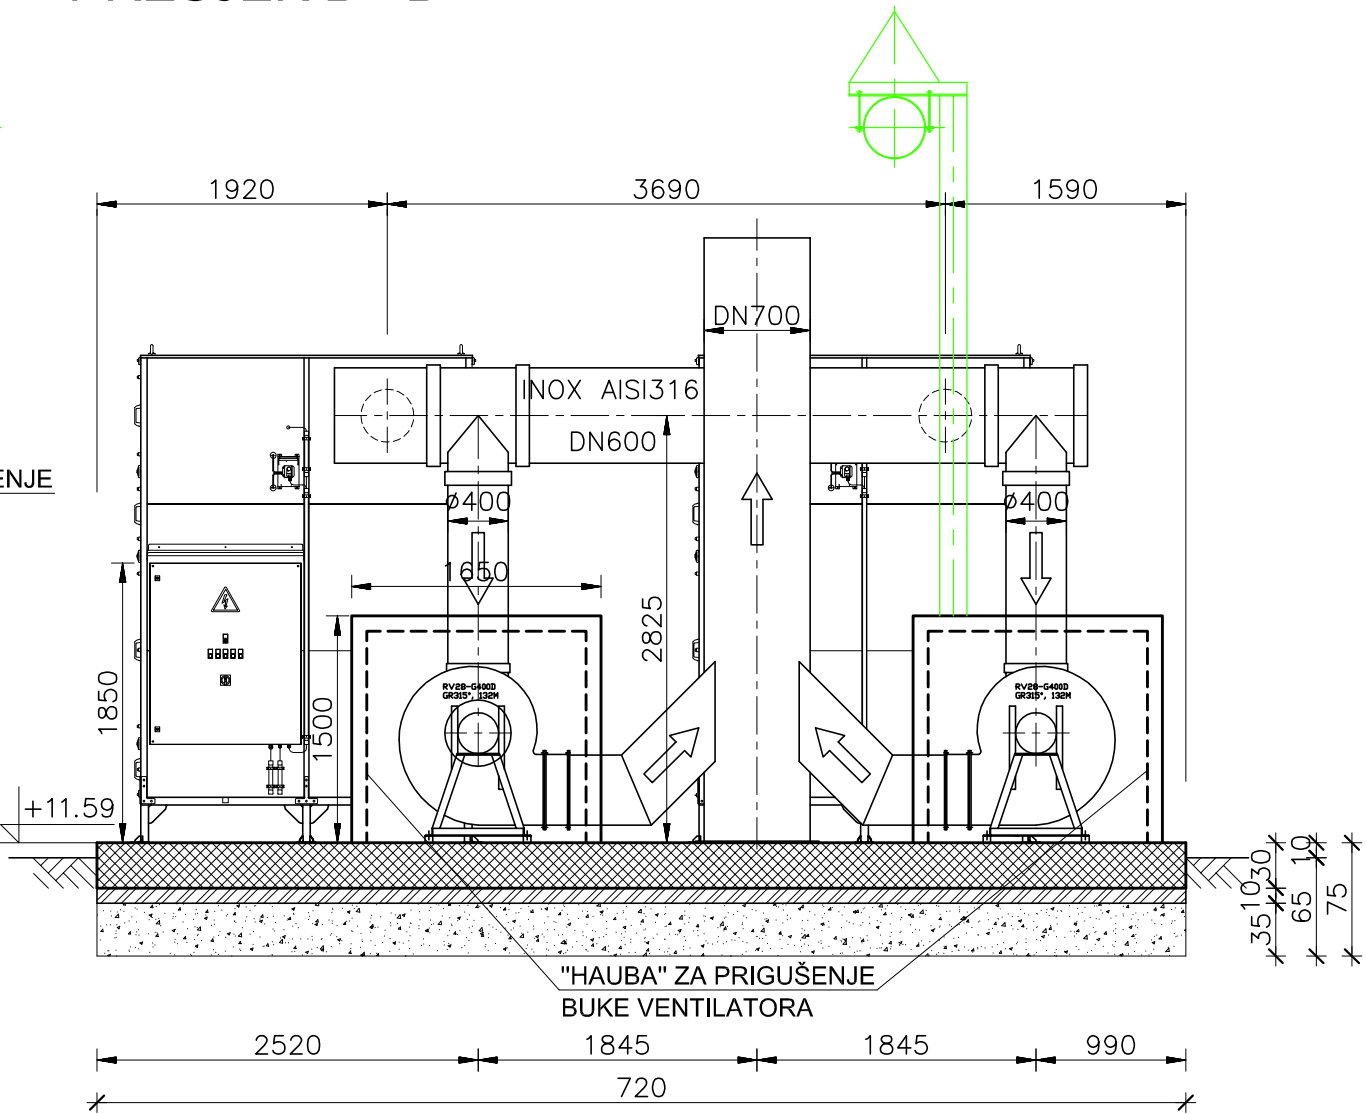

 <b>HIDROPROJEKT-ING</b> PROJEKTIRANJE d.o.o. Draškovićeva 35/1 10000 ZAGREB			
INVESTITOR:	ODVODNJA d.o.o., Hrvatskog Sabora 2/D, 23000 ZADAR		
GRAĐEVINA:	UPOV "Centar" - Zadar - Sustav za fotokatalitičko pročišćavanje zraka		
VRSTA PROJEKTA:	GLAVNI PROJEKT		
MAPA:	1/3	REVIZIJA:	0
PROJEKTANT:	Zoran Kovačev, dipl.ing.stroj.		
SURADNICE:	Lovro Pancić, ing.stroj.		
SADRŽAJ NACRTA/ PRILOGA:	DEHIDRACIJA MULJA PCO JEDINICA - 6000 m <sup>3</sup> /h		
ŠIFRA:	1369	MJERILO:	1:50
BROJ PROJEKTA:	169-1/2016	BROJ PRILOGA:	C.5.